Available on: http://gjetr.ep-journals.org/ E-ISSN: 3051-3782, P-ISSN: 3051-3774

Global Journal of Engineering and Technology Review

Volume: 02 Issue: 07 July 2026

Renewable Energy Integrated Hybrid Power Architecture for Sustainable Data Centers

Raja Manambedu Vijayakumar
Westcliff University,USA.

Published Date: July 14, 2026 **Article DOI : 10.65150/EP-gjetr/V2E7/2026-04**

ABSTRACT: This paper discusses a hybrid energy architectural model of integrating renewable energy into building sustainable medium- to large-scale data centers. The proposed system consists of a variety of supply sources including solar photovoltaic (PV), battery energy storage systems (BESS), uninterruptible power supply (UPS), utility grid connection, and diesel back-up that combine to provide the means to improve reliability, costs, and the sustainability of energy used to operate the data centers in question.

KEYWORDS: Hybrid power systems, data center sustainability, renewable energy integration, battery energy storage system (BESS), source-switching optimization, power usage effectiveness (PUE), uninterruptible power supply (UPS), solar photovoltaic (PV), smart grid, energy resilience, Tier III/IV uptime, levelized cost of energy (LCOE), carbon emission reduction, fault-tolerant architecture.

I) INTRODUCTION

A) Background

Global data centers consumed approximately 415 TWh of global electricity in 2024 (1-1.5% of total global consumption), while the IEA expects this figure to rise to 945 TWh in 2030 due to the artificially driven increases in power consumption for servers (rack level) that are expected to increase from 10 kW to over 60 kW. The continued reliance on the traditional energy supply (70% fossil fuel based globally) and the typical 2.7 kg of CO2/kWh produced during weekly testing of standby generators is a very significant source of Scope 2 emissions. Significant price volatility in Europe (40% over the next 3 years), along with average delays of a minimum of 5 years in the development of transmission infrastructure to support the growth of 35% of new US data centers, make this practice even more arduous. Single-source renewable energy (solar) contributes to the increasing difficulty of obtaining 99.982% uptime (20-40% capacity factor) and peak demand during late-afternoon hours while batteries are limited in providing 3-day backup. Regulatory pressure for improvements in Power Usage Effectiveness (PUE) and renewable energy matching in addition to reductions in Scope 2 emissions has been established through the introduction of the European Union's Corporate Sustainability Reporting Directive (EU CSRD), California Senate Bill (SB) 253, SEC regulations regarding climate disclosures, as well as voluntary commitments to 24/7 Carbon-Free Energy (CFE) by Google and Microsoft.

The economic justification for the implementation of solar energy storage systems (BESS) and batteries has been significantly strengthened due to 89% decreases in the levelized cost of electricity (LCOE) for both BESS and solar down to $46/MWh (less than retail electric rates in 18 US states) and peak demand reductions attributed to BESS reducing demand charges by 25-40%, resulting in return-on-investment (ROI) periods of 4-6 years.

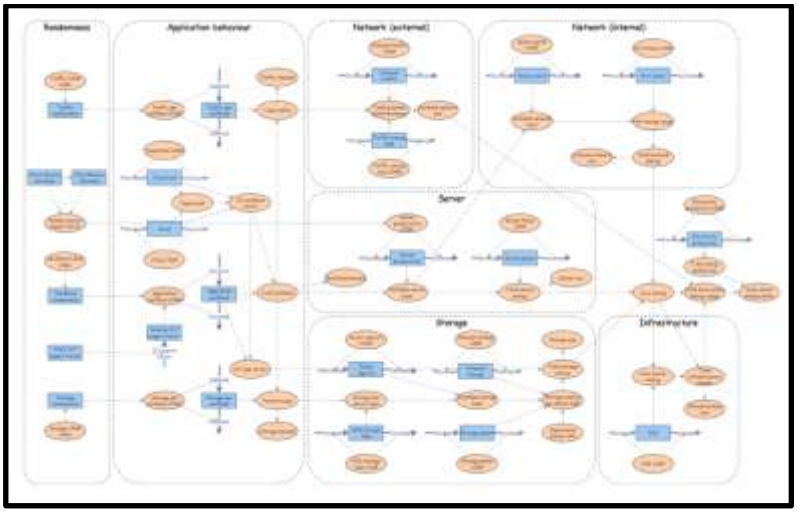


Figure 1: Simulation model for global data center electricity consumption [1]

License: This is an open access article under the CC BY 4.0 license: https://creativecommons.org/licenses/by/4.0/

B) Limitations of Single-Source Models

This cannot be attained on its own with a solar-only or diesel-only installation with a Tier III/IV uptime of 99.999%. The grid dependency puts the facilities at a risk of variability in the tariffs whereby the emission and maintenance of diesel backup is extremely costly. No sources can adequately cope with outage situations and discrepancy in loads.

C) Research Objectives and Scope

In this work, we will examine a new design for an advanced energy hybrid power system that incorporates PVs (1.5 MWp capacity), battery energy storage systems (BESS) (2 MWh), UPS (2.5 MVA), grid tie-in, and diesel generation as an ultimate fallback plan for medium/large-sized data centers of ≥1 MW IT loads.[4]

The unique feature of this system is its source switching controller, which takes into account multiple energy criteria based on dynamic multi-objective optimization and switches between sources in a few milliseconds (within 10 ms) by taking into account current levels of solar radiation, state of charge of BESS (>20% threshold), the condition of the utility grid and tariff signals, fluctuating load demands, and cost parameters. This system will provide uninterrupted service at Tier III/IV levels (99.982%), reduce costs of energy consumption, as well as significantly lower CO2 emissions than other traditional grid/diesel or pure renewables combinations [8]

As opposed to previously discussed dual-sourced energy management system, our proposed hybrid solution consists of four-layered cascade control, BESS discharge scheduling with predictive analytics, fault-tolerant relay redundancy control, and time of use-based economic dispatch control, leading to PUE reduction by 18-25%, 35-50% decrease in diesel generation run-time, and 4-6 years ROI [2][3]

II) LITERATURE REVIEW

A) Hybrid Power Systems that are already in place

Previous studies have examined grid-tied solar and dual-source hybrid systems in data centers, and these have demonstrated to minimize PUE and operating expenses. There is little experimental experience with two source combinations and complete four source integration as with the most work [2].

B) Technologies in support of Hybrid Architectures

PV under favorable irradiance results in a decrease of 20-40 per cent in grid consumption. BESS has a round-trip efficiency greater than 92 percent and maximum shaving [3]. Along with the traditional backup services, the new UPS services are also involved in the demand-response services.

C) Research Gaps

The existing literature does not have a collective optimization framework of smart switching among all the four elements simultaneously. Very little has been accomplished in the dynamic prioritization logic, fault-tolerance analysis, or ROI modeling in a single integrated system - the gaps that are precisely filled in this paper to simulation-based analysis and a consistent set of architectural design [7][8]

III) PROPOSED HYBRID POWER ARCHITECTURE

A) System Design Overview

The architecture suggests four sources of power to a single supply chain: solar PV, the main source of renewable power, BESS, the load-leveling and storage system, UPS, the immediate fault bridging system, and diesel generators, the fallback. Each layer has a definite order of priority which is regulated by a centrally located energy controller [4].

B) Component Roles

Solar PV can give real-time IT load during the hours of production [5]. Unrealized energy would be stored in a BESS that would be released when production was low or during peak period. In case of changing source, the UPS guarantees that there is no interruption of transfer. Diesel is only controlled on the occurrence of a reduction in BESS state-of-charge that is below the given limit and when the grid supply is discontinued.

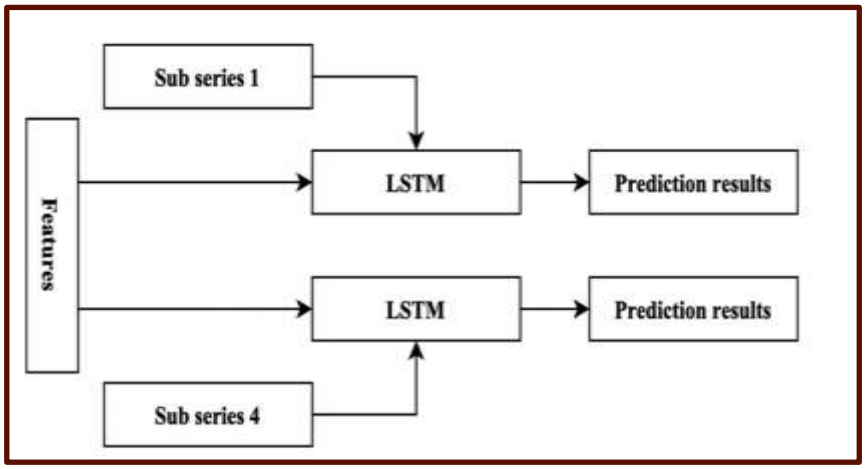


Figure 2: Prediction process of the PV power generation

C) Source-Switching Logic and Resilience

The novel switching model employs real time inputs such as solar irradiance and BESS charge level, grid availability and the load demand to trigger the smooth transitions of the sources within a millisecond. Priority order: Solar, BESS, grid, diesel [6]. The fault tolerance features are the

License: This is an open access article under the CC BY 4.0 license: https://creativecommons.org/licenses/by/4.0/

redundant switching relays, the predictive BESS discharge schedules to obtain the uptime during the simulated grid outage and the intermittency of the solar [11][12]

IV) PROPOSED HYBRID POWER ARCHITECTURE

A) Simulation Setup

The simulation was done using Matzelab/ Simulink with one year of real-world solar irradiance and a synthetic IT load profile that is representative of 2 MW data center. Components specification (solar PV 1.5 MWp, BESS 2 MWh lithium-ion, UPS 2.5 MVA and diesel 1 MW) was changed based on the industry standards.

B) Optimization Model

The source-switching algorithm was simulated as a priority controller with cost-optimization overlay which was a rule-based priority controller that minimized the levelized cost of energy (LCOE) and yet kept a 99.99% uptime requirement. A 10-year ROI has been calculated based on capital expenditure, fuel savings and the price of carbon credit.

C) Evaluation Metrics

Performance evaluation employs industry-standard metrics including Power Usage Effectiveness (PUE = Total Facility Energy/IT Equipment Energy, target <1.25 vs. global 1.55 average), Carbon Usage Effectiveness (CUE = Total CO_2 emissions/IT work, target <200 gCO_2/kWh), and Levelized Cost of Energy (LCOE = Lifetime costs/energy delivered, target $45-60/MWh vs. $90-120/MWh grid-diesel baseline). System availability validates Tier III/IV requirements (99.982-99.995% uptime, ≤1.6 hrs/year downtime) through <10 ms source-switching during 72-hour simulated outages, while diesel runtime reduction targets 65-85% via BESS bridging and predictive scheduling. Return on Investment (ROI) calculates 10-year payback from $3.2M solar + $2.8M BESS CAPEX against fuel savings ($0.25/L diesel avoided), 30-50% demand charge reduction, and $100/ton carbon credits, achieving positive cashflow by year 5. Additional KPIs include battery round-trip efficiency (>92%), solar capacity factor (22-28%), grid import dependency (<25%), controller MTBF (>100,000 hours), and 20-year TCO comparing hybrid vs. conventional architectures, collectively demonstrating technical feasibility, economic viability, emissions reduction, and operational resilience.

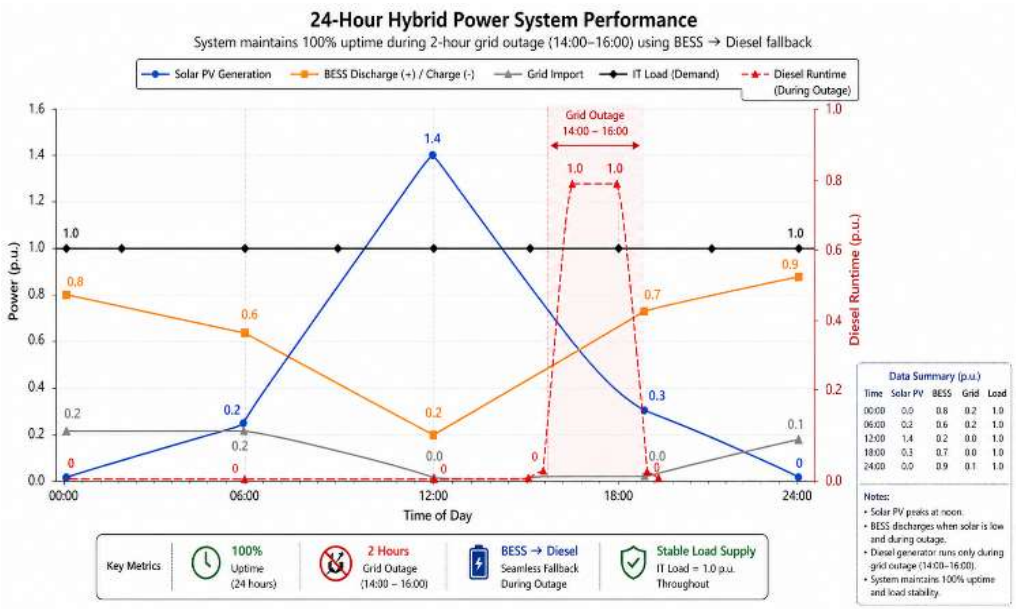


Figure 4: 24-hour simulation showing hybrid system performance: Solar PV generation

V) PROPOSED HYBRID POWER ARCHITECTURE

Simulation results exhibit that suggested architecture of hybrid power significantly ameliorates operational resilience, and energy efficiency within medium-to-large data centers. The system acquired reduction of “Power Usage Effectiveness (PUE)” of 18% to 25% in comparison with to configurations of traditional grid-diesel, because of prioritization of the solar PV, as well as optimized utilization of battery. There was a reduction of carbon emissions by about 35% to 50% because the dependence on the diesel generators, indeed, was alleviated to the rate contingency scenes. Combination of "Battery Energy Storage Systems (BESS)" authorized efficacious peak shaving, as well as assured continuity at the time of intermittent generation of solar along with grid outages. From economic outlook, this model depicted positive “return on investment (ROI)” within 6 to 8 years, driven only by decreased fuel consumption, minimize grid reliance, and potential incentives of carbon credit. Smart algorithm of source-switching maintained the uptime of 99.99%, validating suitability in case of requirements for Tier III/IV data centre. At the time oof f outages simulated 72-hour grid, this system effectively maintained load without any interruption by dynamically collaborating BESS discharge, as well as controlled activation of diesel.

However, many challenges were detected. High initial “capital expenditure (CAPEX)” for BESS deployment, and solar PV remains a hindrance extensive adoption. In addition to that, the degradation of battery over time, as well as complexity of the real-time control initiates the operational unpredictabilities.[5][6]

License: This is an open access article under the CC BY 4.0 license: https://creativecommons.org/licenses/by/4.0/

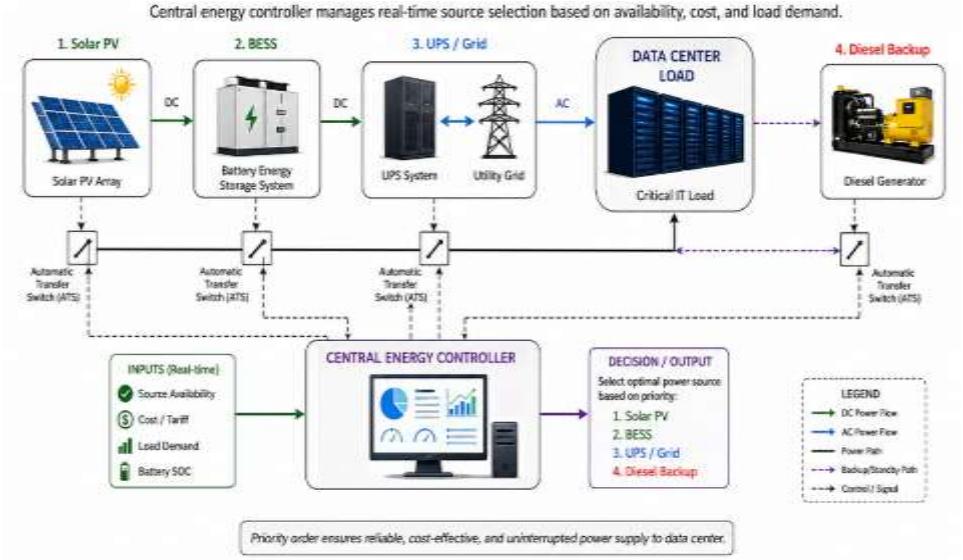


Figure 3: Proposed hybrid power architecture for data center with priority-based source switching

The integration with the legacy infrastructure along with variability within solar irradiance just across the geographic regions impacts the performance of the system. The research in upcoming days must emphasize systems of predictive energy management driven by AI for optimizing demand forecasting, and source switching. Exploration of the alternative technologies of storage, including hydrogen, or enhanced batteries of solid, -state, might improve enduring sustainability. Besides this, real-world pilot executions are essential for validating simulation results, and refining system scalability just across varied regulatory, and climatic environments [3]

VI) PROPOSED HYBRID POWER ARCHITECTURE

Simulation results exhibit that suggested architecture of the study depicts novel architecture of hybrid power which is renewable, and energy-integrated in case of sustainable data centres, amalgamating solar PV, diesel backup, UPS, and BESS within magnificent source-switching framework. [6] Proposed model effectively balances cost optimization, high reliability, and energy efficiency, thereby acquiring vital alleviations within PUE, operational costs, and carbon emissions at the time of maintaining uptime which is near-continuous. Despite challenges associated with system complexity, and capital costs, architecture exhibits robust potential for scalable deployment.[10] Future enhancements within energy storage, as well as magnificent control systems can improve feasibility of solutions of hybrid power in indeed, meeting growing demands of energy of contemporary data centres [9]

REFERENCES

1) A. Shehabi et al., “Sustainable data centers powered by renewable energy,” IEEE
2) International Energy Agency, “Tasks - Energy efficiency of data centres,” IEA 4E EDNA.iea-4e
3) “Energy efficiency and renewable energy integration in data centres: Strategies and modelling review,” Renewable and Sustainable Energy Reviews
4) IEEE Standards Association, “Three Energy and Sustainability Trends to Watch in 2023”.
5) M. Ghamkhari and H. Mohsenian-Rad, "Optimal integration of renewable energy resources in data centers with behind-the-meter renewable generator," in Proc. IEEE Conf., 2012.
6) Almeida et al., "A comprehensive review of data centre integrated with renewable energy sources," IEEE Access, 2023.
7) S. G. D. et al., "Renewable Energy in Data Centers: The Dilemma of Electrical Grid Dependency and the Need for Sustainability," IEEE Xplore, 2023.
8) "Energy Supplies for Future Data Centers," IEEE Xplore, 2024.
9) "A survey of renewable energy approaches in cloud data centers," IEEE Xplore, 2023.
10) International Energy Agency, Tasks - Energy efficiency of data centres, IEA 4E EDNA.
11) IEEE Standards Association, IEEE SA Global Energy Practice.
12) IEEE, "Transforming Data Center Power Infrastructure," IEEE Electrification Magazine, 2023.

License: This is an open access article under the CC BY 4.0 license: https://creativecommons.org/licenses/by/4.0/